


LEGEND:

- 2x4 RECESSED LIGHT FIXTURE
- 1x4 SURFACE MOUNT LIGHT FIXTURE
- STRIP LIGHT
- RECESSED SHIP LIGHT
- DOWN LIGHT
- WALL SCONCE
- PENDANT LIGHT
- DIRECTIONAL LIGHT
- ILLUMINATED EXIT SIGN
- 1000K LIGHT
- SPARKER
- FIG-CRANE DUCTUSER
- SUPPLY AIR DIFFUSER
- LINEAR SUPPLY AIR DIFFUSER
- RETURN AIR DIFFUSER OR TRANSFER GRILL
- EXHAUST GRILLE
- CEILING FAN
- 2x4 SUSPENDED ACOUSTICAL HIE CEILING
- 2x2 SUSPENDED ACOUSTICAL HIE CEILING
- 1/2" THICK GYP BD CEILING UND

NOTE:

- 1 INSTALL FERRING INSULATION ABOVE CONFERENCE AND MECHANICAL ROOM

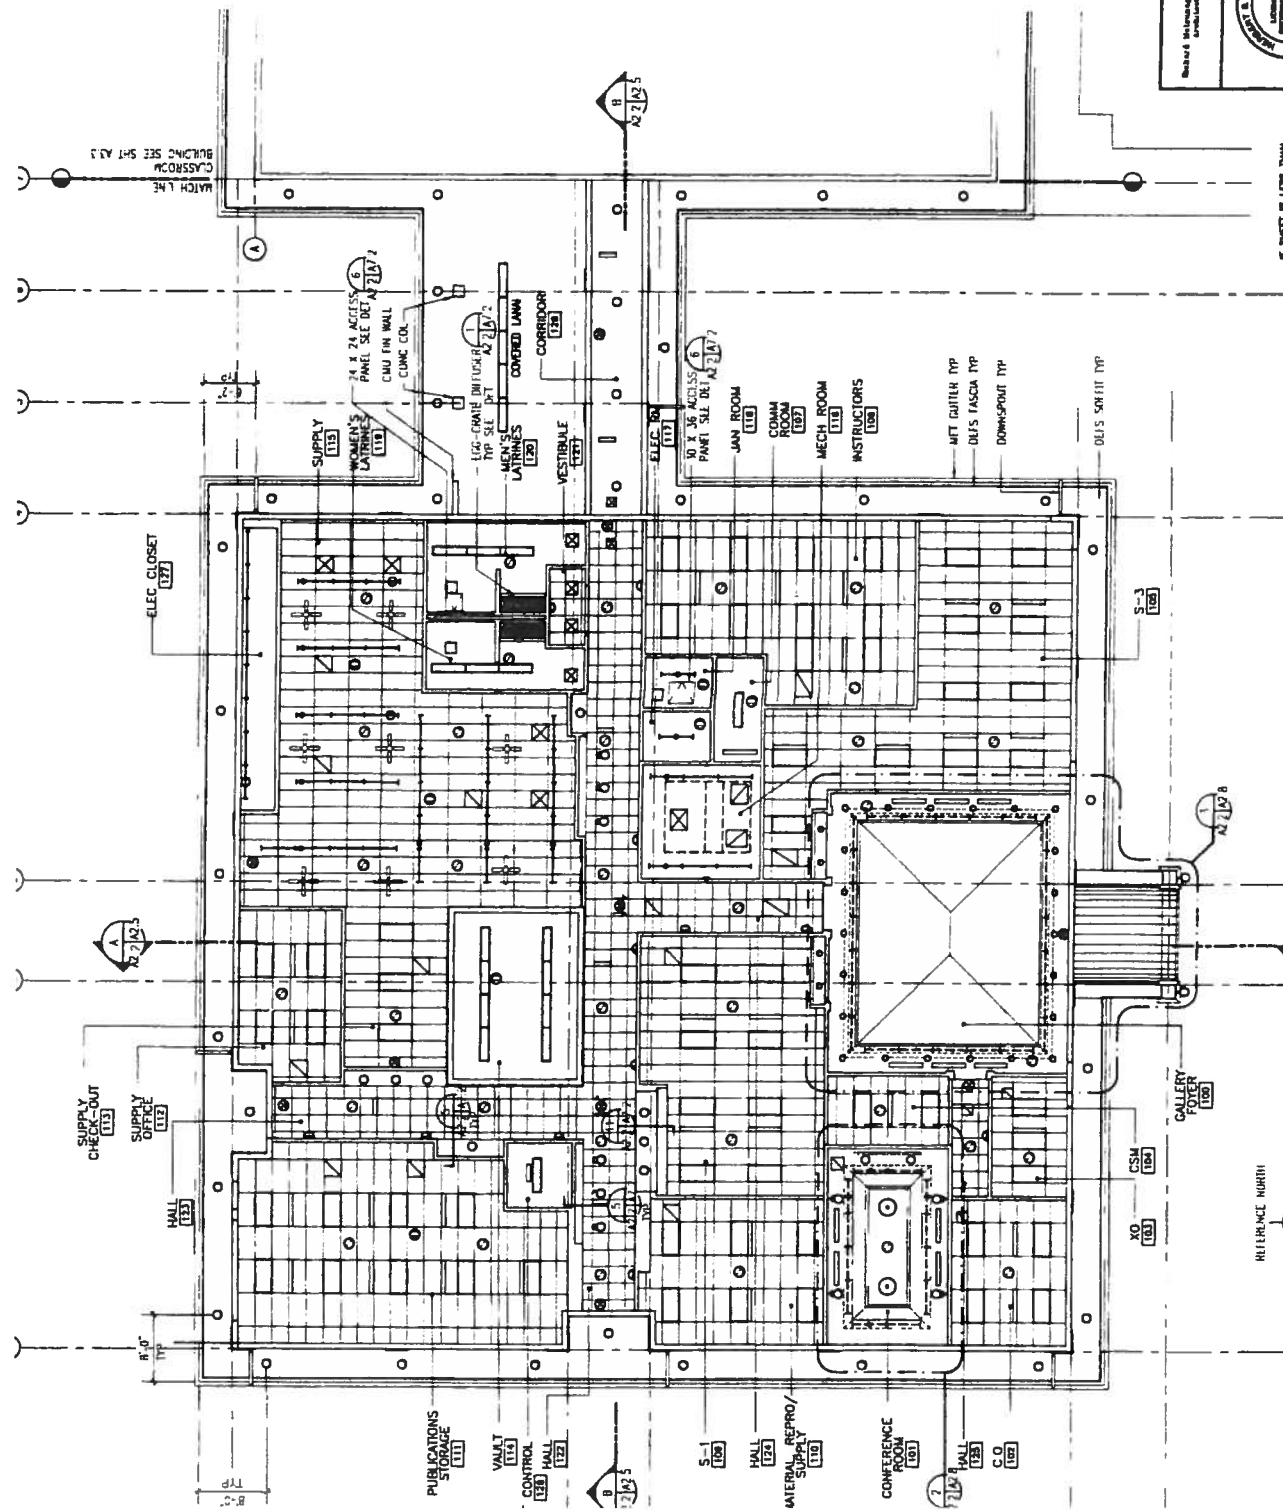

IF SHEET IS LESS THAN 24" X 36" PRINT SCALE REDUCED ACCORDINGLY


The Contractor will be responsible for the installation of the ceiling. The contractor shall be responsible for the removal of all materials and equipment from the site within the contract period.



DEPARTMENTS OF THE ARMY AND AIR NATIONAL GUARD OF HAWAII
OFFICE OF THE ENGINEER, FT. RUGER, HAWAII

PROJECT NO.	DATE
DESCRIPTION	
DESIGNED BY	
CHECKED BY	
DATE	
DEPARTMENTS OF THE ARMY AND AIR NATIONAL GUARD OF HAWAII OFFICE OF THE ENGINEER, FT. RUGER, HAWAII 284TH BELLEVILLE TRAINING CENTER BELLEVILLE AIR FORCE STATION HONOLULU, HAWAII	
ADMINISTRATIVE BUILDING REFLECTED CEILING PLAN	
SCALE	
DATE	
BY	
CHECKED BY	
DATE	

CITED CEILING PLAN



REFERENCE NORTH
WEST EAST SOUTH

